

Ultra Light - Exceptional Strength







Titanium Pool + Spa Heat Exchangers

T100, T200, T300, T400

Technical Product Specifications

HEAT EXCHANGER MODEL	DIMENSIONS					CONNE			
		Α	В	C D		SHELL	TUBES G	HEAT TRANSFER AREA	
	_	^	В			'	J	SQ FT	
		INCHES							
T-100	13.1	4.3	5.3	3.9	3.6	1 1/2	1 1/4	2.24	
T-200	20.9	4.3	13.1	3.9	3.6	1 1/2	1 1/4	4.15	
T-300	29.9	4.3	22.1	3.9	3.6	1 1/2	1 1/4	6.26	
T-400	35.9	4.3	28.1	3.9	3.6	1 1/2	1 1/4	7.71	

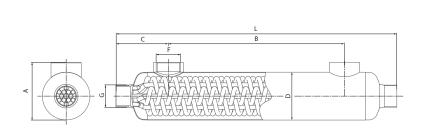



	NOMINAL CAPACITY		HOT WATER SIDE				COLD WATER SIDE			
HEAT EXCHANGER MODEL			FLOW		PRESSURE DROP		FLOW		PRESSURE DROP	
	kW	BTU/hr	LTR/MIN	USG/MIN	kPa	PSI	LTR/MIN	USG/MIN	kPa	PSI
T-100	29	100,000	17	4.6	6.1	0.09	38	10.0	0.3	0.1
T-200	57	200,000	28	7.5	26.7	3.9	61	16.0	1.4	0.2
T-300	87	300,000	36	9.5	63.2	9.2	76	20.0	2.9	0.4
T-400	113	400,000	35	9.1	71.7	10.4	265	70.0	40.7	5.9

Nominal capacity values are based on boiler supply 180°F (82.2°C) and return pool water 80°F (26.7°C).


Evaluate The Boiler Capacity

Ensure that your boiler has enough capacity to reach the required pool temperature, and to maintain it at this temperature through daily use.

To maintain the pool at the required temperature, the boiler should have the capacity to handle the pool heat losses, calculated as:

Heat Loss [Btu/hr] = 12 x [pool surface area (sqft)] x [pool temperature (°F) - air temperature (°F)]

Boiler Selection Chart

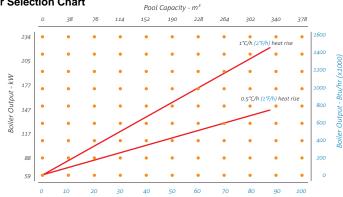

Based on heating source 180°F (82.2°C).

Pool Capacity - USGal (x1000)

In the interest of continuous improvement, specification are subject to change without notice.